

**Project Name: Village Apts Phase III**

**Project Location: 82 Jerome Rd, 15 Jerome Ave & 232 Rt 32**

Reviewing Agency: Fire Marshal

Review Date: 1/25/22

Reviewed By: Paul D. Gaines

	Approved		
	Yes	No	Non-Applicable
Access Drive		X	
Bollards	<del>X</del>		X
Hydrant Locations	X		
Water Storage			X
Building Separation	X		
Fire Lane			X
Propane Tank Location			X



Notes: SHEET 5 Bldg A+B Horse shoe parking/driveway NOT enough turning radius for FD ladder truck. 43' bumper swing.

JEROME AVE ENTRANCE TO Bldg C NO ADEQUATE TURNING RADIUS FOR FD LADDER TRUCK. 43' BUMPER SWING

Electronic Signature:

*Paul D. Gaines*

INFERNO 167 AERIAL - TURNING RADIUS DIAGRAM

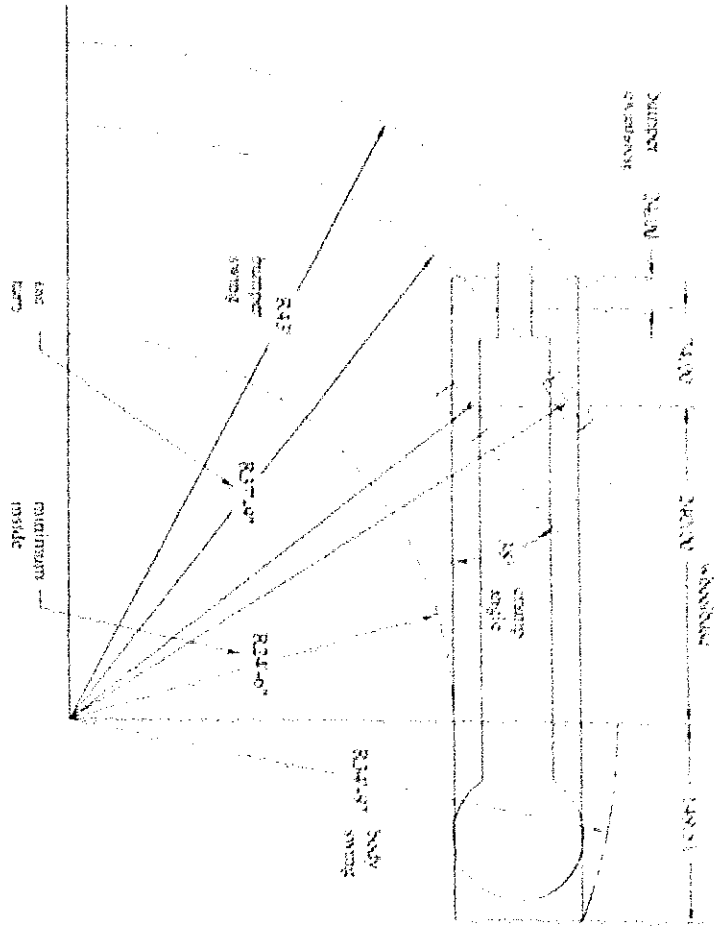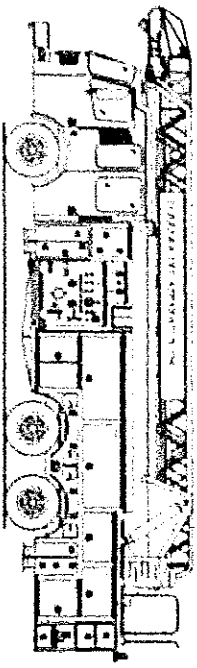

HT 12'  
 weight 73.5  
 len. 44'