

# Stormwater Management Report

## Shantok Village

1758 Route 32, Montville, Connecticut

October 28, 2024

Revised December 6, 2024

Prepared for

1758 RTE 32, LLC

24 Main Street

Centerbrook, CT 06409



**Loureiro Engineering Associates, Inc.**

100 Northwest Drive • Plainville, CT 06062 • 860.747.6181 • Fax 860.747.8822 • [www.Loureiro.com](http://www.Loureiro.com)

An Employee-Owned Company

Comm. No. 064MC4.01

---

**Stormwater Management Report**  
**Shantok Village**  
**1758 Route 32, Montville, Connecticut**

**October 28, 2024**  
**Revised December 6, 2024**

**Prepared for**  
**1758 RTE 32, LLC**  
**24 Main Street**  
**Centerbrook, CT 06409**

**Prepared by**  
**LOUREIRO ENGINEERING ASSOCIATES, INC.**  
**100 Northwest Drive**  
**Plainville, Connecticut 06062**

*An Employee Owned Company*

**Comm. No. 064MC4.01**

---

---

## Table of Contents

	Page
<b>1. INTRODUCTION</b>	<b>1-1</b>
1.1 Background	1-1
1.2 Physical Setting	1-1
1.3 Flood Plain and Soil Conditions	1-1
<b>2. EVALUATION OF EXISTING CONDITIONS</b>	<b>2-1</b>
2.1 Overview	2-1
2.2 Existing Stormwater Management	2-1
2.3 Existing Subcatchment Areas	2-1
<b>3. NEW DEVELOPMENT</b>	<b>3-1</b>
3.1 Overview	3-1
3.2 New Subcatchment Areas	3-1
3.3 Design Criteria & Proposed Stormwater Management Systems	3-1
<b>4. STORMWATER MANAGEMENT EVALUATION</b>	<b>4-2</b>
4.1 Stormwater Runoff Calculations	4-2
4.1.1 Design Criteria & Methodology	4-2
4.1.2 Curve Numbers	4-2
4.2 Existing and New Peak-Flow Comparison	4-3
4.3 Runoff Volume	4-3
4.4 Water Quality	4-4
4.5 Stormwater System Maintenance Program	4-4
<b>5. CONCLUSION</b>	<b>5-1</b>

### DRAWINGS

Drawing DA-1 – Existing Drainage Areas

Drawing DA-2 – New Drainage Areas

### APPENDICIES

Appendix A – USGS Site Location Map

Appendix B – Soil Data

Appendix C – FEMA Flood Map

Appendix D – HydroCAD Reports

Appendix E – Water Quality Volume and Water Quality Flow Calculations

Appendix F – Stormwater Management System Maintenance Program

## **1. INTRODUCTION**

### **1.1 Background**

This stormwater management report has been prepared by Loureiro Engineering Associates, Inc. (LEA) on behalf of 1758 RTE 32, LLC to provide a description and analysis of stormwater management for a new multifamily development. The new work will be completed at two parcels comprised of 1758 & 1790 Route 32, Montville, CT (hereinafter referred to as the “Site”).

### **1.2 Physical Setting**

The Site is 12.19 acres (ac) and is located in the R-20-M and the Route 32 Overlay zones. Both parcels comprising the Site are wooded and vacant. The Site slopes steeply east to west from Route 32, rising from approximately 258 feet to 365 feet (NAVD88). No inland wetlands or other bodies of water are on or are in the vicinity of the Site.

The eastern boundary of the Site is bordered by Route 32 (Norwich New London Turnpike). Wooded residential lots in the R-20 zone surround the Site to the north, west, and south. The Site location is depicted on the United States Geological Survey (USGS) map included as Appendix A.

### **1.3 Flood Plain and Soil Conditions**

The National Resource Conservation Service (NRCS) Soil Survey for the State of Connecticut identified soils as Rainbow silt loam (map unit 44B), Narragansett silt loam of varying slope (66B & 68D), and Charlton-Chatfield complex of varying slopes (73C & 73E). Rainbow silt loam correspond with the Hydrologic Soil Group (HSG) rating D, while all other soil types correspond with the HSG rating B. Ruoff potential for the different HSG soil types varies on a scale with HSG A soils generally having the lowest runoff potential, and HSG D soils having the highest runoff potential.

Falling head permeability tests were run by LEA on representative samples taken from test pits excavated on November 6 & 7, 2023. The lowest permeability rate calculated was 21.6 in/hr. Applying a factor of safety of 50%, in accordance with the 2023 Connecticut Stormwater Quality Manual, a permeability of 10.8 in/hr. was used in drainage calculations. Appendix B includes the NRCS soil map for the site and permeability test results.

Federal Emergency Management Agency’s (FEMA) National Flood Insurance Program (NFIP) Flood Insurance Rate Map (FIRM) Number 09011C0351G, effective July 18, 2011, for Town of

V:\CT\Montville\Route 32-1758\1758 Rte 32, LLC - 064MC4.01\Working Docs\Drainage Report\1758 RT 32 Drainage Report.docx

Montville identifies the entire Site as within Zone X and is designated as an area of minimal flood hazard. Appendix C includes the FEMA FIRM map for the Site.

## **2. EVALUATION OF EXISTING CONDITIONS**

### **2.1 Overview**

The Site currently consists of wooded slopes, and there are no existing buildings, structures, or other types of impervious coverages.

### **2.2 Existing Stormwater Management**

The Site currently has no existing drainage or stormwater management features. Stormwater runoff is conveyed 100 percent (%) through surface runoff. Water travels downslope from the mostly wooded northern portion of the Site (and from adjoining properties upslope) and either flows west off-Site, or east, where it is captured by a 24-inch culvert south of the Site along Route 32. These points of compliance are identified in the drainage analysis as POC 1 and POC 2, respectively, to evaluate peak-flows leaving the Site.

### **2.3 Existing Subcatchment Areas**

The total analyzed drainage area for the Site is approximately 17 acres. As previously mentioned, areas north off-Site runoff towards the Site, increasing the drainage analysis area. The area is divided into two (2) subcatchment areas. Subcatchment area 1 is comprised of the eastern portion of the Site, and flows southeast towards the Route 32 culvert (POC 1). Subcatchment area 2 consists of the western portion of the Site and flows southwest off-Site (POC 2). Both subcatchments are similarly sloped and wooded.

Based upon Site observations, the initial sheet flow is limited due to the slope of the Site, to less than 150 linear feet. Although there is evidence of channelized flow within some areas of the site, the majority of the runoff is expected to be shallow concentrated flow with the obvious channelization occurring in the southeast corner of the site with a southern gradient.

Through available mapping and survey information, both POCs ultimately convey towards Mohegan Brook, which is a tributary of the Thames River. The Existing subcatchment area boundaries are depicted on Drawing DA 1, Existing Drainage Areas.

### **3. NEW DEVELOPMENT**

#### **3.1 Overview**

New development includes the construction of five (5) multifamily residences and a 3,500 sf community building. As the existing Site does not have any utilities or access, the development includes a driveway, curbing, lighting, and utilities.

#### **3.2 New Subcatchment Areas**

The developed Site is divided into twenty-six (26) subcatchments. The majority of the new subcatchments will be captured or conveyed by a new catch basin and swale network. These new drainage features will convey runoff to new retain-it subsurface infiltration or detention systems. Three (3) subcatchments convey stormwater through overland flow and discharge off-Site without being captured by the new drainage system. Runoff from these subcatchments and any stormwater discharged by new infiltration systems will flow off-Site in a manner similar to existing conditions. The new development will result in an increase in impervious area for the drainage analysis area, from 0% to 33.72 %. The new subcatchment area boundaries are depicted on Drawing DA-2, New Drainage Areas plan.

#### **3.3 Design Criteria & Proposed Stormwater Management Systems**

The post-development stormwater runoff analysis was based on the 2-, 10, 25-, 50-, and 100-year 24-hour storm events. The increase in impervious area requires on-Site attenuation to meet or reduce the existing runoff rates as closely as possible.

The new drainage system for the Site will include a manhole, catch basin, and swale network to collect runoff from paved areas and buildings. An infiltration basin has also been designed to capture the large amount of runoff from landscaped sloped areas. The interconnected infiltration systems, using the high infiltration rate of the soils on Site, have been designed to reduce peak flows and the volume of runoff to the Points of Compliance.

To improve stormwater quality discharging from the Site, the infiltration systems have been sized to retain and infiltrate the full water quality volume (WQV). WQV calculations are provided in Appendix E.

## **4. STORMWATER MANAGEMENT EVALUATION**

### **4.1 Stormwater Runoff Calculations**

#### **4.1.1 Design Criteria & Methodology**

Site specific point precipitation frequency estimates used to generate peak stormwater flow were obtained from the National Oceanic and Atmospheric Administration (NOAA) Atlas 14, Volume 10 Version 3: Precipitation-Frequency Atlas of the United States, Northeastern States (rev. 2015). Precipitation-frequency estimates are based upon frequency analysis of partial duration series with a 90% confidence interval of data largely from the National Centers for Environmental Information (NCEI).

The methods described in Urban Hydrology for Small Watersheds, 2nd Edition, (Technical Release Number 55 [TR-55]) from the Natural Resources Conservation Service formerly the Soil Conservation Service – [SCS], 1986) were used to calculate stormwater peak-flow generated from pre- and post-redevelopment conditions. These methods, which are incorporated into the HydroCAD computer software program, use well documented procedures to calculate stormwater runoff volume, peak-flow rate of discharge, hydrographs and storage volumes required for floodwater reservoirs in small watersheds. The method uses the SCS Runoff Curve Number method to estimate runoff volume, calculates times of concentration, produces tabular hydrographs and estimates basin storage capacity.

#### **4.1.2 Curve Numbers**

The curve numbers (CN) values utilized for the analysis of the existing and new conditions included:

Existing/Proposed:

- Woods, CN = 55 (Good woods cover, HSG B)
- Woods, CN = 77 (Good woods cover, HSG D)
- Grassed areas, CN=61 (Good grass cover, HSG B)
- Grassed areas, CN=80 (Good grass cover, HSG D)
- Impervious areas, CN = 98 (Paved parking, roofs, HSG D)

## 4.2 Existing and New Peak-Flow Comparison

As the result of incorporating subsurface infiltration systems into the new stormwater management system, increases in runoff are attenuated to all POC's for all storm events. The table below summarizes the pre- and post-redevelopment

**Table 1 – Peak-Flow Comparison, Cubic Feet per Second (CFS)**

	2-Year Event		10-Year Event		25-Year Event		50-year Event		100-year Event	
	Existing	Proposed	Existing	Proposed	Existing	Proposed	Existing	Proposed	Existing	Proposed
West Off-Site (POC 1)	1.44	0.65	5.39	2.3	8.59	3.42	11.16	4.27	14.08	6.58
Rt. 32 Culvert (POC 2)	2.68	0.14	10.53	1.18	17.02	6.22	22.33	11.15	28.36	16.52
Total	4.12	0.79	15.92	3.48	25.61	9.64	33.49	15.42	42.44	23.1

The analysis indicates overall decreases in peak-flow rates of discharge to points of compliance for all design storms through the 100-year event. The new stormwater management system results in a quantitative and qualitative improvement in the peak flow rates and quality of stormwater discharge from the redeveloped Site. Appendix D includes the HydroCAD reports for both the existing and new conditions analyses.

## 4.3 Runoff Volume

Total runoff from the property was also analyzed volumetrically to ensure similar or lower runoff volumes under new conditions as volumes under existing conditions. The results for the 2-year and 100-year storm events for the total Site are below:

**Table 2 – Total Runoff Volume Comparison, Cubic Feet**

	Existing (cf)	New (cf)	Volume Infiltrated (cf)	Surface Runoff Volume (cf)
2-Year	25,422	84,190	63,180	21,010
100-year	175,953	287,738	159,096	128,642

The tables show that the new infiltration systems reduce total proposed runoff volume below that of existing conditions. Therefore, receiving areas will not receive increased runoff volumes and should not be negatively impacted. Additionally, new scour holes, riprap aprons, and flared end sections will reduce velocity of flow and ensure discharges are non-erosive. Appendix D includes the HydroCAD reports showing runoff volume calculations.

#### 4.4 **Water Quality**

The methods described in the 2023 Connecticut Stormwater Quality Manual were utilized to calculate the WQV of the redevelopment. The WQV for the site is equivalent to the runoff generated with the first 1.3 inches of rainfall. The developed Site is approximately 17 ac and 34% impervious, resulting in a WQV of 26,266 cf. The infiltration systems provide a storage volume of approximately 52,000 cf below the high-level outlets. The infiltration system provides adequate amount of storage to store and infiltrate the WQV. Using permeability test results, the WQV is modelled to drain within 48 hours, meeting State requirements. The drainage system also leads to primary treatment units for treatment prior to entering subsurface infiltration systems. These units are designed to capture oil, trash, and floatables while removing total suspended solids and other pollutants. Appendix E includes the calculation worksheet for Water Quality Volume and Water Quality Flow for the developed catchment areas.

#### 4.5 **Stormwater System Maintenance Program**

To help facilitate the function and longevity of the stormwater management system, maintenance requirements have been provided in Appendix F. The maintenance includes periodic inspections, scheduled cleanings and details on identifying signs of failures in the system. A full checklist of system features shall be completed to provide a log of inspections, cleanings, repairs, and any important information regarding the system. The program will be implemented after installation with more frequent inspections early and fewer inspections after a year or when the system function becomes more predictable. The program, checklist, and past inspection/maintenance logs will be provided to the current or future owners and necessary facility personnel.

## **5. CONCLUSION**

The new development includes a new stormwater management system for the primary conveyance of the stormwater discharging from the Site. The proposed system provides attenuation and treatment of all stormwater events leaving the Site, managing post-development runoff rates and allowing for potential groundwater recharge. The new infiltration systems include sufficient storage capacity for the WQV to offer treatment of Site stormwater, along with treatment of WQF provided by hydrodynamic separators. Overall, the new drainage system will improve water quality discharging from the property while providing lower flow rates and volume to receiving waters.

## **DRAWINGS**



V:\CT\MONTVILLE\ROUTE 32-1758\1758 RTE 32 - 1758\1758\CONSTRUCTION\BASSET DRAINAGE\AREA 5.DWG.DWG DA.2 Sheet: 12/15/2024 4:21 PM by APH/AV Printed: 12/15/2024 4:10 PM




STAMP		NOT FOR CONSTRUCTION FOR COORDINATION ONLY 12/15/2024 6:10:31 PM		REVISIONS PER COMMENTS		DATE		GFA		APPR.	
SCALE 1"=50'		DRAWING NO. 064MC4.01		DATE 7/15/2024		DATE 7/15/2024		GFA		APPR.	
DRAWN BY APH		APPROVED BY GFA		DATE 7/15/2024		DATE 7/15/2024		GFA		APPR.	
NEW DRAINAGE AREAS		SHANTOK VILLAGE 1758 ROUTE 32, MONTVILLE CT 06382 1758 RTE 32, LLC 24 MAIN STREET, CENTERBROOK CT 06409		DATE 7/15/2024		DATE 7/15/2024		GFA		APPR.	
DA 2		NO. OF SHEETS 2		NO. OF SHEETS 2		NO. OF SHEETS 2		NO. OF SHEETS 2		NO. OF SHEETS 2	

**Loureiro**  
Engineering • Construction • EIR • Energy  
Waste • Facility Services • Laboratory  
Loureiro Engineering Associates, Inc.  
Phone: 860-747-6181 • Fax: 860-747-8822  
An Employee-Owned Company • www.loureiro.com  
© Loureiro Engineering Associates, Inc.  
All Rights Reserved 2024

## **APPENDIX A**

### **USGS Site Location Map**

V:\CT\MONTVILLE\ROUTE 32-1758\1758 RTE 32, LLC - 064MC4.01\DWGS\CIVIL\NON PLANSET DWG\SSGS LOCATION MAP.DWG

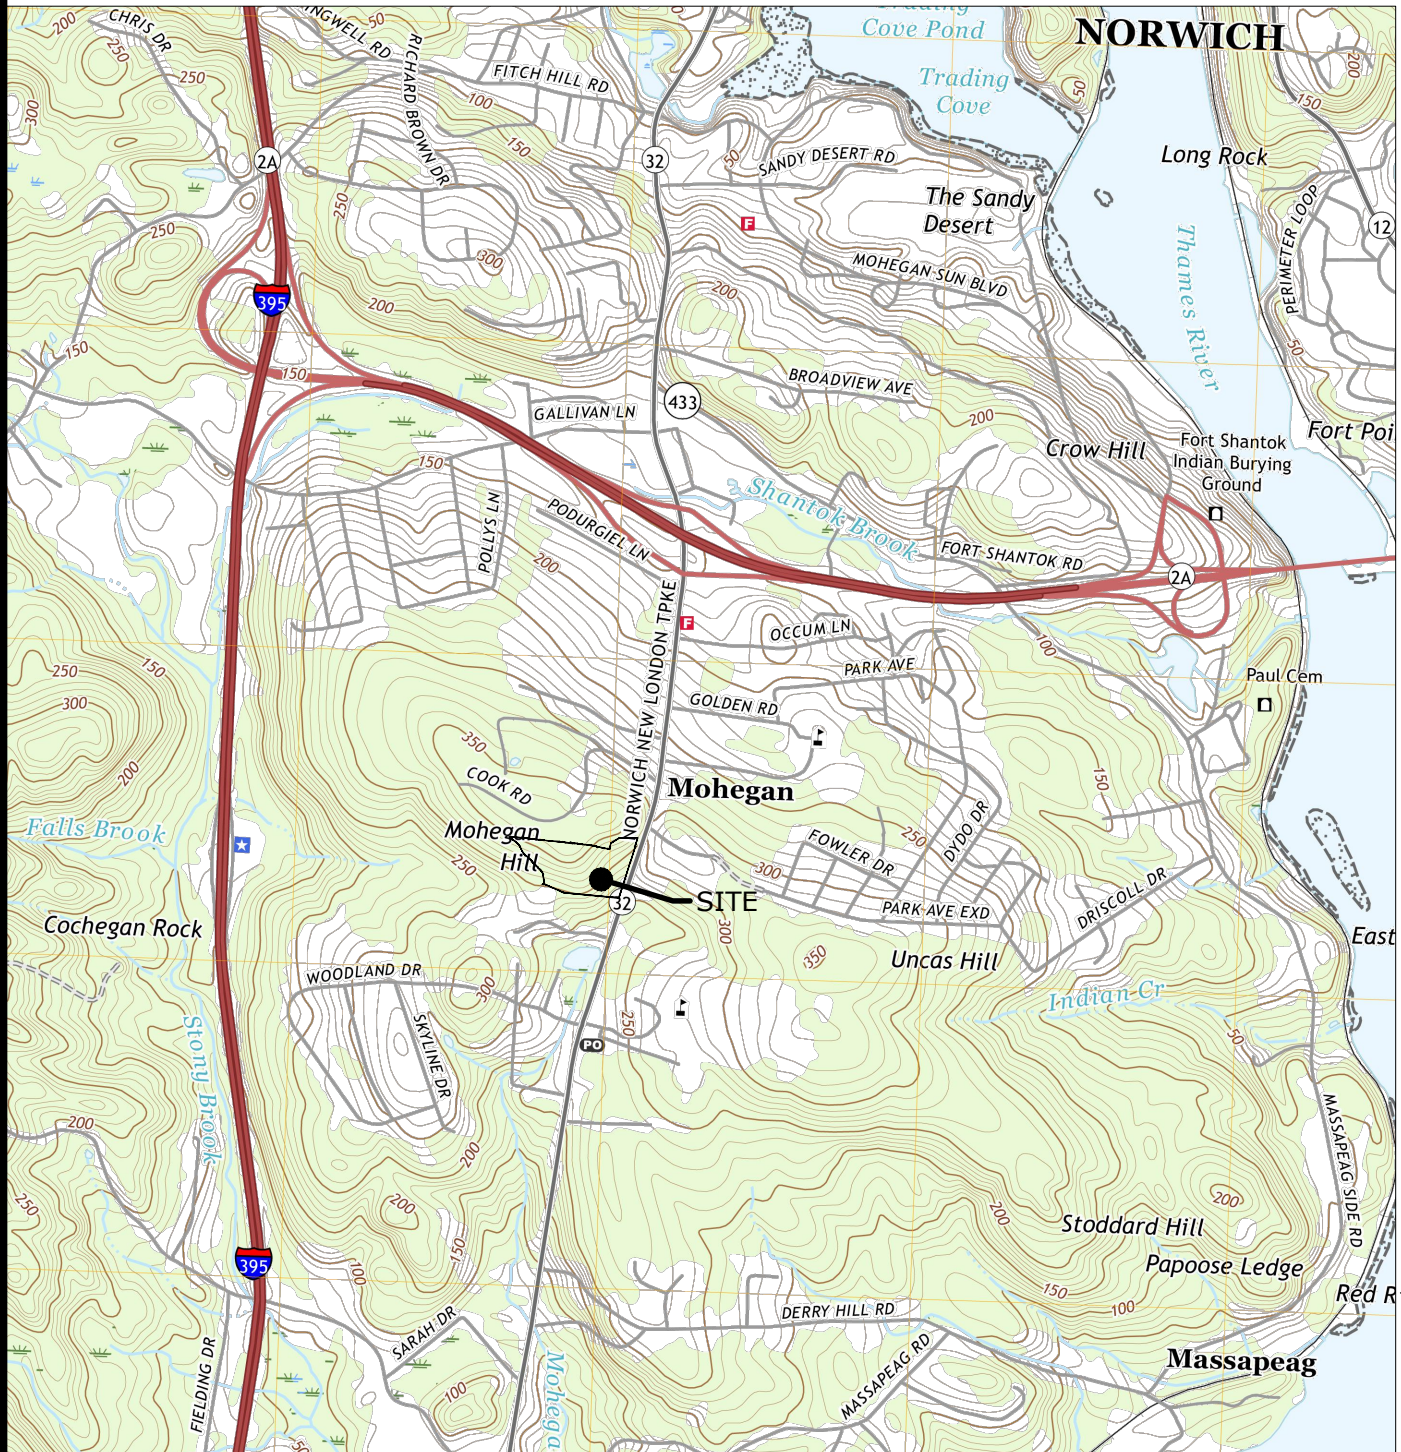

**Loureiro Engineering Associates, Inc.**  
100 Northwest Drive • Plainville, Connecticut 06062  
Phone: 860-747-6181 • Fax: 860-747-8822  
An Employee Owned Company • www.Loureiro.com

©Loureiro Engineering Associates, Inc.  
All Rights Reserved 2024

## SITE LOCATION MAP

### SHANTOK VILLAGE

1758 ROUTE 32, MONTVILLE, CT 06382

PREPARED FOR:

**1758 RTE 32, LLC**

24 MAIN STREET, CENTERBROOK, CT 06409

SCALE

1" = 2000'

COMM. NO.

064MC4.01

DATE

07/12/2024

DRAWING

**FIG 1**

## **APPENDIX B**

### **Soil Data**



United States  
Department of  
Agriculture

NRCS

Natural  
Resources  
Conservation  
Service

A product of the National  
Cooperative Soil Survey,  
a joint effort of the United  
States Department of  
Agriculture and other  
Federal agencies, State  
agencies including the  
Agricultural Experiment  
Stations, and local  
participants

# Custom Soil Resource Report for State of Connecticut, Eastern Part



# Preface

---

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist ([http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2\\_053951](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951)).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

# Contents

---

<b>Preface</b> .....	2
<b>Soil Map</b> .....	5
Soil Map.....	6
Legend.....	7
Map Unit Legend.....	8
Map Unit Descriptions.....	8
State of Connecticut, Eastern Part.....	11
44B—Rainbow silt loam, 2 to 8 percent slopes, very stony.....	11
45C—Woodbridge fine sandy loam, 8 to 15 percent slopes.....	12
50A—Sutton fine sandy loam, 0 to 3 percent slopes.....	14
60C—Canton and Charlton fine sandy loams, 8 to 15 percent slopes.....	16
66B—Narragansett silt loam, 2 to 8 percent slopes.....	18
68D—Narragansett silt loam, 15 to 25 percent slopes, extremely stony.....	20
73C—Charlton-Chatfield complex, 0 to 15 percent slopes, very rocky.....	22
73E—Charlton-Chatfield complex, 15 to 45 percent slopes, very rocky.....	24
74C—Narragansett-Hollis complex, 3 to 15 percent slopes, very rocky.....	26
<b>Soil Information for All Uses</b> .....	30
Soil Properties and Qualities.....	30
Soil Qualities and Features.....	30
Hydrologic Soil Group.....	30

# Soil Map

---

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.


# Custom Soil Resource Report Soil Map




# Custom Soil Resource Report


## MAP LEGEND

### Area of Interest (AOI)

 Area of Interest (AOI)


### Soils


 Soil Map Unit Polygons


 Soil Map Unit Lines


 Soil Map Unit Points

### Special Point Features

 Blowout

 Borrow Pit


 Clay Spot


 Closed Depression

 Gravel Pit


 Gravelly Spot


 Landfill

 Lava Flow

 Marsh or swamp

 Mine or Quarry

 Miscellaneous Water


 Perennial Water

 Rock Outcrop


 Saline Spot

 Sandy Spot

 Severely Eroded Spot


 Sinkhole


 Slide or Slip

 Sodic Spot

 Spoil Area

 Stony Spot


 Very Stony Spot

 Wet Spot

 Other


 Special Line Features

### Water Features

 Streams and Canals


### Transportation

 Rails


 Interstate Highways

 US Routes

 Major Roads

 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:12,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
Web Soil Survey URL:  
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: State of Connecticut, Eastern Part  
Survey Area Data: Version 1, Sep 15, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 14, 2022—Oct 6, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
44B	Rainbow silt loam, 2 to 8 percent slopes, very stony	2.7	8.6%
45C	Woodbridge fine sandy loam, 8 to 15 percent slopes	0.0	0.0%
50A	Sutton fine sandy loam, 0 to 3 percent slopes	0.6	1.9%
60C	Canton and Charlton fine sandy loams, 8 to 15 percent slopes	1.3	4.0%
66B	Narragansett silt loam, 2 to 8 percent slopes	3.4	10.6%
68D	Narragansett silt loam, 15 to 25 percent slopes, extremely stony	4.8	14.9%
73C	Charlton-Chatfield complex, 0 to 15 percent slopes, very rocky	2.8	8.8%
73E	Charlton-Chatfield complex, 15 to 45 percent slopes, very rocky	15.5	48.4%
74C	Narragansett-Hollis complex, 3 to 15 percent slopes, very rocky	0.9	2.9%
<b>Totals for Area of Interest</b>		<b>32.0</b>	<b>100.0%</b>

## Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a

particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

## Custom Soil Resource Report

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

## State of Connecticut, Eastern Part

### 44B—Rainbow silt loam, 2 to 8 percent slopes, very stony

#### Map Unit Setting

*National map unit symbol:* 9Inp

*Elevation:* 0 to 1,200 feet

*Mean annual precipitation:* 43 to 56 inches

*Mean annual air temperature:* 45 to 55 degrees F

*Frost-free period:* 140 to 185 days

*Farmland classification:* Farmland of statewide importance

#### Map Unit Composition

*Rainbow and similar soils:* 80 percent

*Minor components:* 20 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Rainbow

##### Setting

*Landform:* Hills, drumlins

*Down-slope shape:* Linear

*Across-slope shape:* Concave

*Parent material:* Eolian deposits over coarse-loamy lodgment till derived from gneiss and/or schist and/or sandstone and/or basalt

##### Typical profile

*Ap - 0 to 6 inches:* silt loam

*Bw1 - 6 to 18 inches:* silt loam

*Bw2 - 18 to 26 inches:* silt loam

*2Cd - 26 to 65 inches:* gravelly fine sandy loam

##### Properties and qualities

*Slope:* 3 to 8 percent

*Surface area covered with cobbles, stones or boulders:* 1.6 percent

*Depth to restrictive feature:* 20 to 40 inches to densic material

*Drainage class:* Moderately well drained

*Runoff class:* Medium

*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately high (0.00 to 0.20 in/hr)

*Depth to water table:* About 18 to 30 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water supply, 0 to 60 inches:* Low (about 4.9 inches)

##### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 6s

*Hydrologic Soil Group:* C/D

*Ecological site:* F144AY037MA - Moist Dense Till Uplands

*Hydric soil rating:* No

#### Minor Components

##### Sutton, very stony

*Percent of map unit:* 5 percent

## Custom Soil Resource Report

*Landform:* Drainageways, depressions  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

### **Broadbrook**

*Percent of map unit:* 5 percent  
*Landform:* Till plains, hills, drumlins  
*Down-slope shape:* Linear  
*Across-slope shape:* Concave  
*Hydric soil rating:* No

### **Narragansett**

*Percent of map unit:* 2 percent  
*Landform:* Till plains, hills  
*Down-slope shape:* Linear  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

### **Ridgebury**

*Percent of map unit:* 2 percent  
*Landform:* Drainageways, depressions  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

### **Unnamed, nonstony surface**

*Percent of map unit:* 2 percent  
*Hydric soil rating:* No

### **Wilbraham**

*Percent of map unit:* 2 percent  
*Landform:* Drainageways, depressions  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

### **Woodbridge**

*Percent of map unit:* 2 percent  
*Landform:* Hills, drumlins  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

## **45C—Woodbridge fine sandy loam, 8 to 15 percent slopes**

### **Map Unit Setting**

*National map unit symbol:* 2w689  
*Elevation:* 0 to 1,370 feet  
*Mean annual precipitation:* 36 to 71 inches  
*Mean annual air temperature:* 39 to 55 degrees F  
*Frost-free period:* 140 to 240 days

## Custom Soil Resource Report

*Farmland classification:* Farmland of statewide importance

### Map Unit Composition

*Woodbridge and similar soils:* 85 percent

*Minor components:* 15 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### Description of Woodbridge

#### Setting

*Landform:* Ground moraines, hills, drumlins

*Landform position (two-dimensional):* Footslope, backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Convex

*Across-slope shape:* Linear

*Parent material:* Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

#### Typical profile

*Ap - 0 to 7 inches:* fine sandy loam

*Bw1 - 7 to 18 inches:* fine sandy loam

*Bw2 - 18 to 30 inches:* fine sandy loam

*Cd - 30 to 65 inches:* gravelly fine sandy loam

#### Properties and qualities

*Slope:* 8 to 15 percent

*Depth to restrictive feature:* 20 to 39 inches to densic material

*Drainage class:* Moderately well drained

*Runoff class:* Very high

*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately low (0.00 to 0.14 in/hr)

*Depth to water table:* About 18 to 30 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water supply, 0 to 60 inches:* Low (about 4.7 inches)

#### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 3e

*Hydrologic Soil Group:* C/D

*Ecological site:* F144AY037MA - Moist Dense Till Uplands

*Hydric soil rating:* No

### Minor Components

#### Paxton

*Percent of map unit:* 10 percent

*Landform:* Ground moraines, hills, drumlins

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Convex, linear

*Across-slope shape:* Convex

*Hydric soil rating:* No

#### Ridgebury

*Percent of map unit:* 4 percent

## Custom Soil Resource Report

*Landform:* Depressions, ground moraines, hills, drainageways, drumlins  
*Landform position (two-dimensional):* Toeslope, footslope  
*Landform position (three-dimensional):* Base slope, head slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

### **Sutton**

*Percent of map unit:* 1 percent  
*Landform:* Ground moraines, hills  
*Landform position (two-dimensional):* Footslope  
*Landform position (three-dimensional):* Base slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

## **50A—Sutton fine sandy loam, 0 to 3 percent slopes**

### **Map Unit Setting**

*National map unit symbol:* 2xffg  
*Elevation:* 0 to 1,240 feet  
*Mean annual precipitation:* 36 to 71 inches  
*Mean annual air temperature:* 39 to 55 degrees F  
*Frost-free period:* 140 to 240 days  
*Farmland classification:* All areas are prime farmland

### **Map Unit Composition**

*Sutton and similar soils:* 85 percent  
*Minor components:* 15 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Sutton**

#### **Setting**

*Landform:* Ground moraines, ridges, hills  
*Landform position (two-dimensional):* Footslope  
*Landform position (three-dimensional):* Base slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Parent material:* Coarse-loamy melt-out till derived from gneiss, granite, and/or schist

#### **Typical profile**

*Ap - 0 to 5 inches:* fine sandy loam  
*Bw1 - 5 to 17 inches:* fine sandy loam  
*Bw2 - 17 to 25 inches:* sandy loam  
*C1 - 25 to 39 inches:* gravelly sandy loam  
*C2 - 39 to 60 inches:* gravelly sandy loam

#### **Properties and qualities**

*Slope:* 0 to 3 percent

## Custom Soil Resource Report

*Depth to restrictive feature:* More than 80 inches  
*Drainage class:* Moderately well drained  
*Runoff class:* Very high  
*Capacity of the most limiting layer to transmit water (Ksat):* Moderately low to high  
(0.14 to 14.17 in/hr)  
*Depth to water table:* About 12 to 27 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Maximum salinity:* Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)  
*Available water supply, 0 to 60 inches:* Moderate (about 8.3 inches)

### Interpretive groups

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 2w  
*Hydrologic Soil Group:* B/D  
*Ecological site:* F144AY008CT - Moist Till Uplands  
*Hydric soil rating:* No

### Minor Components

#### Leicester

*Percent of map unit:* 5 percent  
*Landform:* Ground moraines, hills, drainageways, depressions  
*Landform position (two-dimensional):* Toeslope, footslope  
*Landform position (three-dimensional):* Base slope  
*Down-slope shape:* Concave, linear  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

#### Charlton

*Percent of map unit:* 5 percent  
*Landform:* Ground moraines, ridges, hills  
*Landform position (two-dimensional):* Shoulder, summit  
*Landform position (three-dimensional):* Crest  
*Down-slope shape:* Convex, linear  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

#### Canton

*Percent of map unit:* 4 percent  
*Landform:* Hills, moraines, ridges  
*Landform position (two-dimensional):* Shoulder, summit  
*Landform position (three-dimensional):* Crest  
*Down-slope shape:* Convex, linear  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

#### Whitman

*Percent of map unit:* 1 percent  
*Landform:* Ground moraines, drumlins, hills, drainageways, depressions  
*Landform position (two-dimensional):* Toeslope  
*Landform position (three-dimensional):* Base slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

## **60C—Canton and Charlton fine sandy loams, 8 to 15 percent slopes**

### **Map Unit Setting**

*National map unit symbol:* 2w81z

*Elevation:* 0 to 1,620 feet

*Mean annual precipitation:* 36 to 71 inches

*Mean annual air temperature:* 39 to 55 degrees F

*Frost-free period:* 140 to 240 days

*Farmland classification:* Farmland of statewide importance

### **Map Unit Composition**

*Canton and similar soils:* 50 percent

*Charlton and similar soils:* 35 percent

*Minor components:* 15 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Canton**

#### **Setting**

*Landform:* Hills, moraines, ridges

*Landform position (two-dimensional):* Backslope, shoulder, summit

*Landform position (three-dimensional):* Side slope, nose slope, crest

*Down-slope shape:* Convex, linear

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy over sandy melt-out till derived from gneiss, granite, and/or schist

#### **Typical profile**

*Ap - 0 to 7 inches:* fine sandy loam

*Bw1 - 7 to 15 inches:* fine sandy loam

*Bw2 - 15 to 26 inches:* gravelly fine sandy loam

*2C - 26 to 65 inches:* gravelly loamy sand

#### **Properties and qualities**

*Slope:* 8 to 15 percent

*Depth to restrictive feature:* 19 to 39 inches to strongly contrasting textural stratification

*Drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately low to high (0.14 to 14.17 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water supply, 0 to 60 inches:* Very low (about 2.7 inches)

#### **Interpretive groups**

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 3e

*Hydrologic Soil Group:* B

## Custom Soil Resource Report

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

### Description of Charlton

#### Setting

*Landform:* Ridges, ground moraines, hills

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Convex, linear

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy melt-out till derived from granite, gneiss, and/or schist

#### Typical profile

*Ap - 0 to 7 inches:* fine sandy loam

*Bw - 7 to 22 inches:* gravelly fine sandy loam

*C - 22 to 65 inches:* gravelly fine sandy loam

#### Properties and qualities

*Slope:* 8 to 15 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately low to high  
(0.14 to 14.17 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water supply, 0 to 60 inches:* Moderate (about 6.9 inches)

#### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 3e

*Hydrologic Soil Group:* B

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

### Minor Components

#### Leicester

*Percent of map unit:* 5 percent

*Landform:* Ground moraines, drainageways, depressions, hills

*Landform position (two-dimensional):* Toeslope, footslope

*Landform position (three-dimensional):* Base slope

*Down-slope shape:* Concave, linear

*Across-slope shape:* Concave

*Hydric soil rating:* Yes

#### Sutton

*Percent of map unit:* 5 percent

*Landform:* Ridges, hills, ground moraines

*Landform position (two-dimensional):* Footslope

*Landform position (three-dimensional):* Base slope

*Down-slope shape:* Concave

*Across-slope shape:* Linear

*Hydric soil rating:* No

**Chatfield**

*Percent of map unit:* 5 percent

*Landform:* Ridges, hills

*Landform position (two-dimensional):* Backslope, shoulder, summit

*Landform position (three-dimensional):* Crest, side slope, nose slope

*Down-slope shape:* Convex

*Across-slope shape:* Linear, convex

*Hydric soil rating:* No

**66B—Narragansett silt loam, 2 to 8 percent slopes**

**Map Unit Setting**

*National map unit symbol:* 9lq3

*Elevation:* 0 to 1,200 feet

*Mean annual precipitation:* 43 to 54 inches

*Mean annual air temperature:* 45 to 55 degrees F

*Frost-free period:* 140 to 185 days

*Farmland classification:* All areas are prime farmland

**Map Unit Composition**

*Narragansett and similar soils:* 80 percent

*Minor components:* 20 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

**Description of Narragansett**

**Setting**

*Landform:* Till plains, hills

*Down-slope shape:* Linear

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy eolian deposits over sandy and gravelly melt-out till derived from gneiss and/or schist and/or sandstone and shale

**Typical profile**

*Ap - 0 to 6 inches:* silt loam

*Bw1 - 6 to 15 inches:* silt loam

*Bw2 - 15 to 24 inches:* silt loam

*Bw3 - 24 to 28 inches:* gravelly silt loam

*2C - 28 to 60 inches:* very gravelly loamy coarse sand

**Properties and qualities**

*Slope:* 2 to 8 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high to high (0.57 to 1.98 in/hr)

*Depth to water table:* More than 80 inches

## Custom Soil Resource Report

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water supply, 0 to 60 inches:* Moderate (about 6.3 inches)

### **Interpretive groups**

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 2e

*Hydrologic Soil Group:* B

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

### **Minor Components**

#### **Charlton**

*Percent of map unit:* 5 percent

*Landform:* Hills

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### **Broadbrook**

*Percent of map unit:* 5 percent

*Landform:* Till plains, hills, drumlins

*Down-slope shape:* Linear

*Across-slope shape:* Concave

*Hydric soil rating:* No

#### **Leicester**

*Percent of map unit:* 3 percent

*Landform:* Drainageways, depressions

*Down-slope shape:* Linear

*Across-slope shape:* Concave

*Hydric soil rating:* Yes

#### **Canton**

*Percent of map unit:* 2 percent

*Landform:* Hills

*Down-slope shape:* Linear

*Across-slope shape:* Convex

*Hydric soil rating:* No

#### **Unnamed, red parent material**

*Percent of map unit:* 2 percent

*Hydric soil rating:* No

#### **Wapping**

*Percent of map unit:* 2 percent

*Landform:* Till plains, hills

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### **Sutton**

*Percent of map unit:* 1 percent

*Landform:* Drainageways, depressions

*Down-slope shape:* Concave

*Across-slope shape:* Linear

*Hydric soil rating:* No

## **68D—Narragansett silt loam, 15 to 25 percent slopes, extremely stony**

### **Map Unit Setting**

*National map unit symbol:* 9lq8

*Elevation:* 0 to 1,200 feet

*Mean annual precipitation:* 43 to 54 inches

*Mean annual air temperature:* 45 to 55 degrees F

*Frost-free period:* 140 to 185 days

*Farmland classification:* Not prime farmland

### **Map Unit Composition**

*Narragansett and similar soils:* 80 percent

*Minor components:* 20 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Narragansett**

#### **Setting**

*Landform:* Till plains, hills

*Down-slope shape:* Linear

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy eolian deposits over sandy and gravelly melt-out till derived from gneiss and/or schist and/or sandstone and shale

#### **Typical profile**

*Ap - 0 to 6 inches:* silt loam

*Bw1 - 6 to 15 inches:* silt loam

*Bw2 - 15 to 24 inches:* silt loam

*Bw3 - 24 to 28 inches:* gravelly silt loam

*2C - 28 to 60 inches:* very gravelly loamy coarse sand

#### **Properties and qualities**

*Slope:* 15 to 25 percent

*Surface area covered with cobbles, stones or boulders:* 9.0 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Well drained

*Runoff class:* Medium

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high to high (0.57 to 1.98 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water supply, 0 to 60 inches:* Moderate (about 6.3 inches)

#### **Interpretive groups**

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 7s

*Hydrologic Soil Group:* B

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

## Minor Components

### **Broadbrook**

*Percent of map unit:* 5 percent  
*Landform:* Till plains, hills, drumlins  
*Down-slope shape:* Linear  
*Across-slope shape:* Concave  
*Hydric soil rating:* No

### **Charlton**

*Percent of map unit:* 5 percent  
*Landform:* Hills  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

### **Leicester**

*Percent of map unit:* 3 percent  
*Landform:* Drainageways, depressions  
*Down-slope shape:* Linear  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

### **Wapping**

*Percent of map unit:* 2 percent  
*Landform:* Till plains, hills  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

### **Canton**

*Percent of map unit:* 2 percent  
*Landform:* Hills  
*Down-slope shape:* Linear  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

### **Unnamed, red parent material**

*Percent of map unit:* 2 percent  
*Hydric soil rating:* No

### **Sutton, extremely stony**

*Percent of map unit:* 1 percent  
*Landform:* Drainageways, depressions  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

## **73C—Charlton-Chatfield complex, 0 to 15 percent slopes, very rocky**

### **Map Unit Setting**

*National map unit symbol:* 2w698

*Elevation:* 0 to 1,550 feet

*Mean annual precipitation:* 36 to 71 inches

*Mean annual air temperature:* 39 to 55 degrees F

*Frost-free period:* 140 to 240 days

*Farmland classification:* Not prime farmland

### **Map Unit Composition**

*Charlton, very stony, and similar soils:* 50 percent

*Chatfield, very stony, and similar soils:* 30 percent

*Minor components:* 20 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Charlton, Very Stony**

#### **Setting**

*Landform:* Ridges, hills

*Landform position (two-dimensional):* Backslope, shoulder, summit

*Landform position (three-dimensional):* Side slope, crest, nose slope

*Down-slope shape:* Convex, linear

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy melt-out till derived from granite, gneiss, and/or schist

#### **Typical profile**

*Oe - 0 to 2 inches:* moderately decomposed plant material

*A - 2 to 4 inches:* fine sandy loam

*Bw - 4 to 27 inches:* gravelly fine sandy loam

*C - 27 to 65 inches:* gravelly fine sandy loam

#### **Properties and qualities**

*Slope:* 3 to 15 percent

*Surface area covered with cobbles, stones or boulders:* 1.6 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately low to high  
(0.14 to 14.17 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water supply, 0 to 60 inches:* Moderate (about 8.7 inches)

#### **Interpretive groups**

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 6s

## Custom Soil Resource Report

*Hydrologic Soil Group:* B

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

### Description of Chatfield, Very Stony

#### Setting

*Landform:* Hills, ridges

*Landform position (two-dimensional):* Backslope, summit, shoulder

*Landform position (three-dimensional):* Crest, side slope, nose slope

*Down-slope shape:* Convex

*Across-slope shape:* Linear, convex

*Parent material:* Coarse-loamy melt-out till derived from granite, gneiss, and/or schist

#### Typical profile

*Oi - 0 to 1 inches:* slightly decomposed plant material

*A - 1 to 2 inches:* fine sandy loam

*Bw - 2 to 30 inches:* gravelly fine sandy loam

*2R - 30 to 40 inches:* bedrock

#### Properties and qualities

*Slope:* 3 to 15 percent

*Surface area covered with cobbles, stones or boulders:* 1.6 percent

*Depth to restrictive feature:* 20 to 41 inches to lithic bedrock

*Drainage class:* Well drained

*Runoff class:* High

*Capacity of the most limiting layer to transmit water (Ksat):* Very low (0.00 to 0.00 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water supply, 0 to 60 inches:* Low (about 4.3 inches)

#### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 6s

*Hydrologic Soil Group:* B

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

### Minor Components

#### Sutton, very stony

*Percent of map unit:* 5 percent

*Landform:* Ground moraines, hills

*Landform position (two-dimensional):* Footslope

*Landform position (three-dimensional):* Base slope

*Down-slope shape:* Concave

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### Rock outcrop

*Percent of map unit:* 5 percent

*Hydric soil rating:* No

**Hollis, very stony**

*Percent of map unit:* 5 percent

*Landform:* Hills, ridges

*Landform position (two-dimensional):* Backslope, shoulder, summit

*Landform position (three-dimensional):* Crest, side slope, nose slope

*Down-slope shape:* Convex

*Across-slope shape:* Linear, convex

*Hydric soil rating:* No

**Leicester, very stony**

*Percent of map unit:* 5 percent

*Landform:* Drainageways, depressions

*Down-slope shape:* Linear

*Across-slope shape:* Concave

*Hydric soil rating:* Yes

**73E—Charlton-Chatfield complex, 15 to 45 percent slopes, very rocky**

**Map Unit Setting**

*National map unit symbol:* 9lql

*Elevation:* 0 to 1,200 feet

*Mean annual precipitation:* 43 to 56 inches

*Mean annual air temperature:* 45 to 55 degrees F

*Frost-free period:* 140 to 185 days

*Farmland classification:* Not prime farmland

**Map Unit Composition**

*Charlton and similar soils:* 45 percent

*Chatfield and similar soils:* 30 percent

*Minor components:* 25 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

**Description of Charlton**

**Setting**

*Landform:* Hills

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Parent material:* Coarse-loamy melt-out till derived from granite and/or schist and/or gneiss

**Typical profile**

*Ap - 0 to 4 inches:* fine sandy loam

*Bw1 - 4 to 7 inches:* fine sandy loam

*Bw2 - 7 to 19 inches:* fine sandy loam

*Bw3 - 19 to 27 inches:* gravelly fine sandy loam

*C - 27 to 65 inches:* gravelly fine sandy loam

## Custom Soil Resource Report

### Properties and qualities

*Slope:* 15 to 45 percent  
*Surface area covered with cobbles, stones or boulders:* 1.6 percent  
*Depth to restrictive feature:* More than 80 inches  
*Drainage class:* Well drained  
*Runoff class:* High  
*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high to high (0.57 to 5.95 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water supply, 0 to 60 inches:* Low (about 5.9 inches)

### Interpretive groups

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 7s  
*Hydrologic Soil Group:* B  
*Ecological site:* F144AY034CT - Well Drained Till Uplands  
*Hydric soil rating:* No

### Description of Chatfield

#### Setting

*Landform:* Ridges, hills  
*Down-slope shape:* Convex  
*Across-slope shape:* Linear  
*Parent material:* Coarse-loamy melt-out till derived from granite and/or schist and/or gneiss

#### Typical profile

*Oa - 0 to 1 inches:* highly decomposed plant material  
*A - 1 to 6 inches:* gravelly fine sandy loam  
*Bw1 - 6 to 15 inches:* gravelly fine sandy loam  
*Bw2 - 15 to 29 inches:* gravelly fine sandy loam  
*2R - 29 to 80 inches:* unweathered bedrock

### Properties and qualities

*Slope:* 15 to 45 percent  
*Surface area covered with cobbles, stones or boulders:* 1.6 percent  
*Depth to restrictive feature:* 20 to 40 inches to lithic bedrock  
*Drainage class:* Well drained  
*Runoff class:* High  
*Capacity of the most limiting layer to transmit water (Ksat):* Low to high (0.01 to 5.95 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water supply, 0 to 60 inches:* Low (about 3.3 inches)

### Interpretive groups

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 7s  
*Hydrologic Soil Group:* B  
*Ecological site:* F144AY034CT - Well Drained Till Uplands  
*Hydric soil rating:* No

**Minor Components**

**Rock outcrop**

*Percent of map unit:* 10 percent  
*Hydric soil rating:* No

**Leicester**

*Percent of map unit:* 5 percent  
*Landform:* Drainageways, depressions  
*Down-slope shape:* Linear  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

**Sutton, very stony**

*Percent of map unit:* 5 percent  
*Landform:* Drainageways, depressions  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

**Hollis**

*Percent of map unit:* 3 percent  
*Landform:* Ridges, hills  
*Down-slope shape:* Convex  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

**Unnamed, sandy subsoil**

*Percent of map unit:* 1 percent  
*Hydric soil rating:* No

**Unnamed, red parent material**

*Percent of map unit:* 1 percent  
*Hydric soil rating:* No

**74C—Narragansett-Hollis complex, 3 to 15 percent slopes, very rocky**

**Map Unit Setting**

*National map unit symbol:* 9lqm  
*Elevation:* 0 to 1,200 feet  
*Mean annual precipitation:* 43 to 56 inches  
*Mean annual air temperature:* 45 to 55 degrees F  
*Frost-free period:* 140 to 185 days  
*Farmland classification:* Not prime farmland

**Map Unit Composition**

*Narragansett and similar soils:* 55 percent  
*Hollis and similar soils:* 20 percent  
*Minor components:* 25 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

## Description of Narragansett

### Setting

*Landform:* Till plains, hills

*Down-slope shape:* Linear

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy eolian deposits over sandy and gravelly melt-out till derived from gneiss and/or schist and/or sandstone and shale

### Typical profile

*Ap - 0 to 6 inches:* silt loam

*Bw1 - 6 to 15 inches:* silt loam

*Bw2 - 15 to 24 inches:* silt loam

*Bw3 - 24 to 28 inches:* gravelly silt loam

*2C - 28 to 60 inches:* very gravelly loamy coarse sand

### Properties and qualities

*Slope:* 3 to 15 percent

*Surface area covered with cobbles, stones or boulders:* 1.6 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Well drained

*Runoff class:* Medium

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high to high (0.57 to 1.98 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water supply, 0 to 60 inches:* Moderate (about 6.3 inches)

### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 6s

*Hydrologic Soil Group:* B

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

## Description of Hollis

### Setting

*Landform:* Ridges, hills

*Down-slope shape:* Convex

*Across-slope shape:* Convex

*Parent material:* Loamy melt-out till derived from granite and/or schist and/or gneiss

### Typical profile

*Oa - 0 to 1 inches:* highly decomposed plant material

*A - 1 to 6 inches:* gravelly fine sandy loam

*Bw1 - 6 to 9 inches:* channery fine sandy loam

*Bw2 - 9 to 15 inches:* gravelly fine sandy loam

*2R - 15 to 80 inches:* bedrock

### Properties and qualities

*Slope:* 3 to 15 percent

*Surface area covered with cobbles, stones or boulders:* 1.6 percent

*Depth to restrictive feature:* 10 to 20 inches to lithic bedrock

*Drainage class:* Somewhat excessively drained

## Custom Soil Resource Report

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Low to high (0.01 to 5.95 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water supply, 0 to 60 inches:* Very low (about 1.8 inches)

### **Interpretive groups**

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 6s

*Hydrologic Soil Group:* D

*Ecological site:* F144AY033MA - Shallow Dry Till Uplands

*Hydric soil rating:* No

### **Minor Components**

#### **Rock outcrop**

*Percent of map unit:* 6 percent

*Hydric soil rating:* No

#### **Charlton**

*Percent of map unit:* 5 percent

*Landform:* Hills

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### **Chatfield**

*Percent of map unit:* 5 percent

*Landform:* Ridges, hills

*Down-slope shape:* Convex

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### **Leicester**

*Percent of map unit:* 3 percent

*Landform:* Drainageways, depressions

*Down-slope shape:* Linear

*Across-slope shape:* Concave

*Hydric soil rating:* Yes

#### **Wapping**

*Percent of map unit:* 2 percent

*Landform:* Till plains, hills

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### **Canton**

*Percent of map unit:* 2 percent

*Landform:* Hills

*Down-slope shape:* Linear

*Across-slope shape:* Convex

*Hydric soil rating:* No

#### **Sutton, very stony**

*Percent of map unit:* 2 percent

## Custom Soil Resource Report

*Landform:* Drainageways, depressions

*Down-slope shape:* Concave

*Across-slope shape:* Linear

*Hydric soil rating:* No

# **Soil Information for All Uses**

---

## **Soil Properties and Qualities**

The Soil Properties and Qualities section includes various soil properties and qualities displayed as thematic maps with a summary table for the soil map units in the selected area of interest. A single value or rating for each map unit is generated by aggregating the interpretive ratings of individual map unit components. This aggregation process is defined for each property or quality.

## **Soil Qualities and Features**

Soil qualities are behavior and performance attributes that are not directly measured, but are inferred from observations of dynamic conditions and from soil properties. Example soil qualities include natural drainage, and frost action. Soil features are attributes that are not directly part of the soil. Example soil features include slope and depth to restrictive layer. These features can greatly impact the use and management of the soil.

## **Hydrologic Soil Group**

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.


## Custom Soil Resource Report

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.


If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

# Custom Soil Resource Report Map—Hydrologic Soil Group

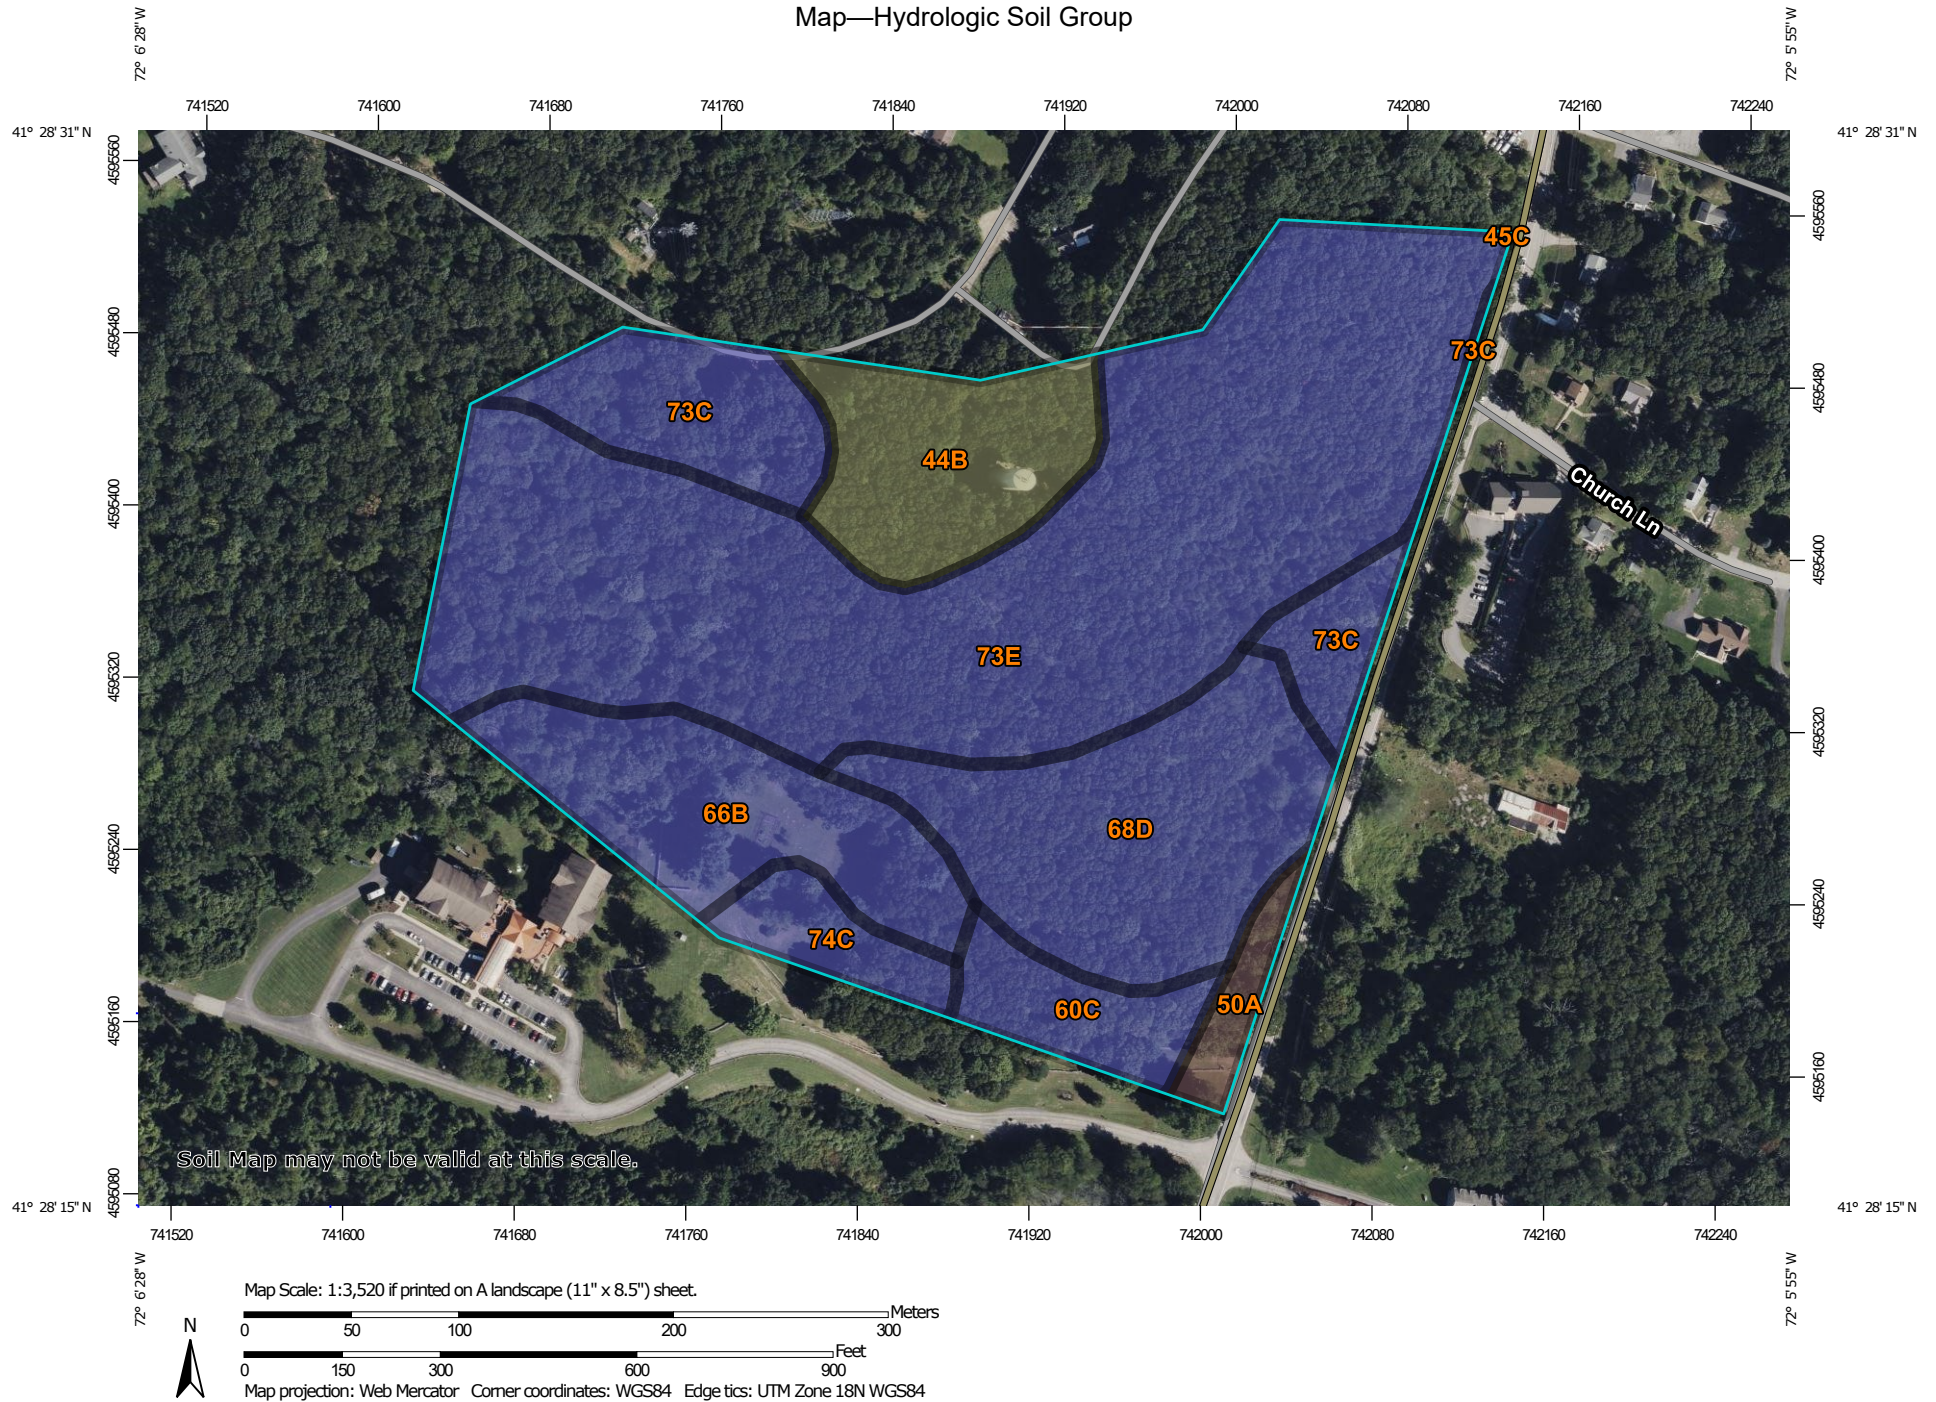








## MAP LEGEND

### Area of Interest (AOI)









 Area of Interest (AOI)

### Soils

#### Soil Rating Polygons





 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Lines


 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Points






 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available

### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:12,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: State of Connecticut, Eastern Part  
 Survey Area Data: Version 1, Sep 15, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 14, 2022—Oct 6, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

**Table—Hydrologic Soil Group**

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
44B	Rainbow silt loam, 2 to 8 percent slopes, very stony	C/D	2.7	8.6%
45C	Woodbridge fine sandy loam, 8 to 15 percent slopes	C/D	0.0	0.0%
50A	Sutton fine sandy loam, 0 to 3 percent slopes	B/D	0.6	1.9%
60C	Canton and Charlton fine sandy loams, 8 to 15 percent slopes	B	1.3	4.0%
66B	Narragansett silt loam, 2 to 8 percent slopes	B	3.4	10.6%
68D	Narragansett silt loam, 15 to 25 percent slopes, extremely stony	B	4.8	14.9%
73C	Charlton-Chatfield complex, 0 to 15 percent slopes, very rocky	B	2.8	8.8%
73E	Charlton-Chatfield complex, 15 to 45 percent slopes, very rocky	B	15.5	48.4%
74C	Narragansett-Hollis complex, 3 to 15 percent slopes, very rocky	B	0.9	2.9%
<b>Totals for Area of Interest</b>			<b>32.0</b>	<b>100.0%</b>

**Rating Options—Hydrologic Soil Group***Aggregation Method:* Dominant Condition*Component Percent Cutoff:* None Specified*Tie-break Rule:* Higher

### Falling Head Permeability Test

#### TP-1

Sample taken 11/6/23 from 4'-100' layer

$$K = \frac{(H_1 - H_2) \cdot L}{t \cdot \frac{(H_1 + H_2)}{2}}$$

$$K = \frac{(12' - 10') \cdot 7'}{0.95 \text{ min} \cdot \frac{(12' + 10')}{2}} = \frac{14'}{10.45 \text{ min}} = \boxed{1.3' / \text{min}}$$

$$L = 7'$$

$$H_1 = 12'$$

$$H_2 = 10'$$

$$t = 0.95 \text{ minutes (57 seconds)}$$

#### TP-17A

Sample taken 11/6/23 from 36'-74' layer

$$L = 7.5'$$

$$H_1 = 12'$$

$$H_2 = 9.5'$$

$$t = 1.22 \text{ min (1 minute, 13 seconds)}$$

$$K = \frac{(12' - 9.5') \cdot 7.5'}{1.22 \text{ min} \cdot \frac{(12' + 9.5')}{2}} = \frac{18.75'}{13.12 \text{ min}} = \boxed{1.43' / \text{min}}$$

#### TP-14

Sample taken 11/6/23 from 40'-100' layer

$$L = 2'$$

$$H_1 = 12'$$

$$H_2 = 8.75'$$

$$t = 1.72 \text{ minutes (103 seconds)}$$

$$K = \frac{(12' - 8.75') \cdot 2'}{1.72 \text{ min} \cdot \frac{(12' + 8.75')}{2}} = \frac{6.5'}{17.845 \text{ min}} = \boxed{0.36' / \text{min}}$$

### TP-10

• Sample taken 11/7/23 from 28'-84' layer

$$L = 7'$$

$$H_1 = 12'$$

$$H_2 = 11'$$

$$t = 1.31 \text{ min (68 seconds)}$$

$$K = \frac{(12' - 11') \cdot 7'}{1.31 \text{ min} \cdot \frac{(12' + 11')}{2}} = \frac{7'}{13 \text{ min}} = \boxed{0.54 \text{ in/min}}$$

### TP-12

• Sample taken 11/7/23 from 32'-96' layer

$$L = 7.5'$$

$$H_1 = 12'$$

$$H_2 = 10.75'$$

$$t = 0.824 \text{ min (49 seconds)}$$

$$K = \frac{(12' - 10.75') \cdot 7.5'}{0.824 \text{ min} \cdot \frac{(12' + 10.75')}{2}} = \frac{9.375'}{9.375 \text{ min}} = \boxed{1.0 \text{ in/min}}$$

### TP-6

• Sample taken 11/7/23 from 46'-99' layer

$$L = 8.5'$$

$$H_1 = 12'$$

$$H_2 = 11'$$

$$t = 0.654 \text{ min (39 seconds)}$$

$$K = \frac{(12' - 11') \cdot 8.5'}{0.654 \text{ min} \cdot \frac{(12' + 11')}{2}} = \frac{8.5'}{7.5 \text{ min}} = \boxed{1.13 \text{ in/min}}$$

### TP-21

• Sample taken 11/7/23 from 30'-78' layer

$$L = 6.5'$$

$$H_1 = 12'$$

$$H_2 = 6.5'$$

$$t = 1.71 \text{ min (103 seconds)}$$

$$K = \frac{(12' - 6.5') \cdot 6.5'}{1.71 \text{ min} \cdot \frac{(12' + 6.5')}{2}} = \frac{35.75'}{15.82 \text{ min}} = \boxed{2.26 \text{ in/min}}$$

## **APPENDIX C**

### **FEMA Flood Map**